


JOINT DETAIL



NOTES:

1. WATER TIGHT JOINTS MADE IN ACCORDANCE WITH ASTM C76/C443/C361 & C655, GREENBOOK S 207-2 AND CALTRANS S 65 REQUIREMENTS.
2. LAYING LENGTHS 8' & 4' AS REQUIRED.
3. ALL CONCRETE USED IN THE MANUFACTURE OF RCP PRODUCTS CONTAINS TYPE II/V CEMENT PORTLAND CEMENT CONFORMING TO ASTM C-150.
4. AVERAGE JOINT GAP IS 0.04" (1/2").
5. STEEL REINFORCEMENT NOT SHOWN.
6. ALL DIMENSIONS SUBJECT TO ALLOWABLE SPECIFICATION TOLERANCES AND PARAMETERS.
7. BEVEL PIPE FOR 45 RADIUS MINIMUM.

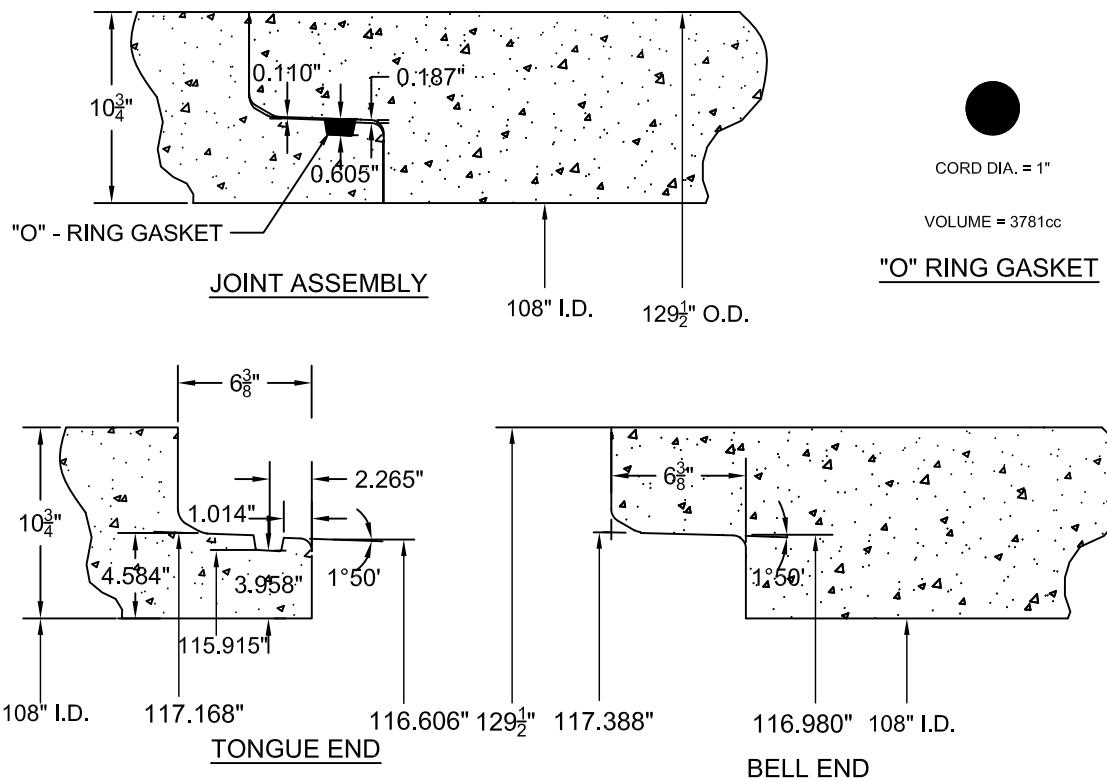

3011 NORTH LAUREL AVE. RIALTO, CA 92377

JOB NAME: STANDARD PRODUCT		108" REINFORCED CONCRETE PIPE / CONFINED "O"-RING JOINT STANDARD DRAWING FOR DRYCAST			DRAWING SCALE (UNO)
LOCATION: TBD		DRAWN BY FB	CHECKED BY KB	PART NO. 1080008000R000	DATE 10/14/2016
		DRAWING NUMBER	ORING_108inRCP_07252012		SHEET 1 OF 1